




CCIS TOOLBOX TALKS

Electrical Panel and Main Switch

TOPIC: Electrical Main Switch and Panel Required Clearance Requirements

Are you protecting yourself from electric shock and burns? You're not if you fail to comply with the following three clearance requirements in Sec. 110-26 of the National Electrical Code (NEC): 1) at least a 3-ft clearance in front of all electrical equipment; 2) a 30 in.-wide working space in front of equipment operating at 600V or less; and 3) minimum headroom clearance of 6 ft or the height of the equipment, whichever is greater.

Does your facility have live electrical panels that has material placed in front of it? (If so, create an exclusion zone like below and mark the action on the Sign in Sheet.)

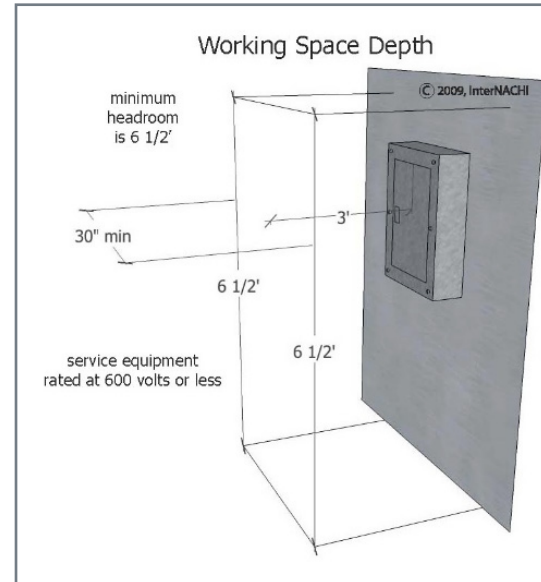

Electrical Panels be marked to notify people they are not to block.

Document any safety observations and corrective actions on the "Safety Observation" sections of the sign in sheet, scan completed document and send to : jspivak@ccpipeline.com.



CCIS TOOLBOX TALKS

Location:	Date:
Manager:	Meeting Lead:

Name	Title

Other Topics

Safety Observation:

Safety Observation:

Safety Observation: